



IP68 CONNECTORS

These IP68 rated connectors are quick-install solutions for pass-thru, panel interface connectivity. Your choice of either a shielded Cat 6 Ethernet or 3.0 USB connector with an IP68 rated twist-off cap for protection. These IP68 Connectors provide protection when submerged in up to 1.5 meters of water for 60 minutes. These connectors can be ordered as a standalone component or with a 6' cable and can be installed on any control panel with a 25.2 mm knock-out. The external twist-off cap and severe environment cable both maintain an IP68 rating.

APPLICATION

Ethernet and USB networking continue to be a growing solution for PLC programming and industrial applications. Ethernet connectors are a standardized telecommunication network interface to allow quick and easy connection your server, modem, or router within your local network. For both component options, users can simply connect their laptop and perform the necessary programming for their PLCs safely with panel door closed.



Don't see what you're looking for?

Contact us at sales@gracetechnologies.com, call 1-800-280-9517 or visit www.graceport.com to chat with our customer service.

Connector Code	Description
C-P33-KIT	3.0 USB-A F/F Bulkhead (Package of Qty 5)
C-P33-C6-KIT	3.0 USB-A F/M 6' Cable (Package of Qty 5)
C-R31-KIT	Shielded CAT6 F/F Bulkhead (Package of Qty 5)
C-R31-C6-KIT	Shielded CAT6 F/M 6' Cable (Package of Qty 5)

Continued on back

FOR MORE INFORMATION VISIT GRACEPORT.COM OR CALL 1.800.280.9517

Warning: Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.


© Grace Technologies, Inc. All rights reserved. Specifications are subject to change with/without notice.




GP-IP68C-DS-EN 2303

DETAILS

C-R31-KIT

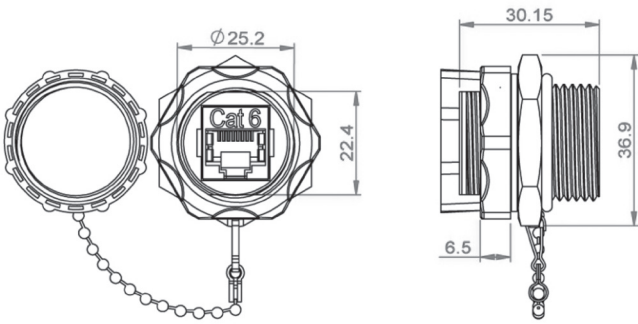

C-P33-KIT

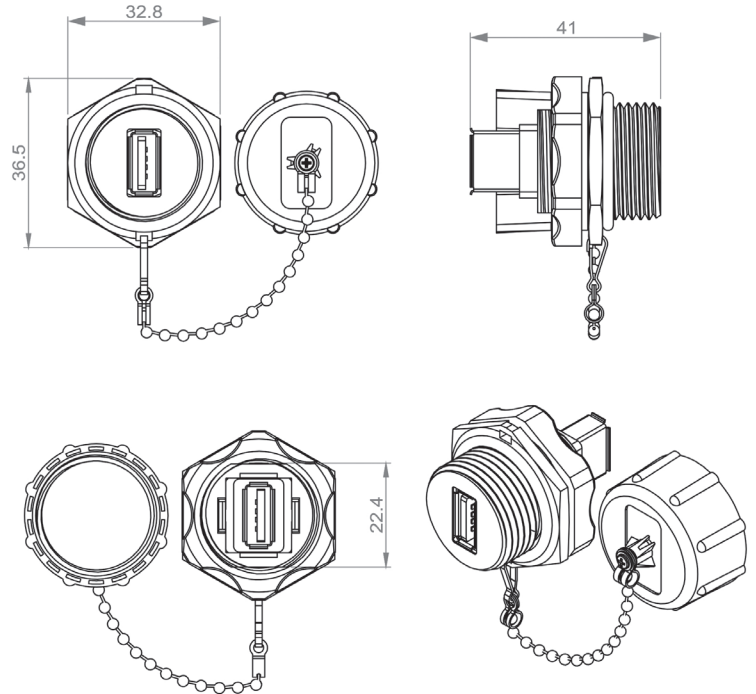

FOR MORE INFORMATION VISIT GRACEPORT.COM OR CALL 1.800.280.9517

Warning: Verify an electrical conductor has been de-energized using an adequately rated test instrument before working on it. Follow appropriate Energy Control (Lockout/Tagout) procedures as per OSHA Subpart S.

© Grace Technologies, Inc. All rights reserved. Specifications are subject to change with/without notice.



GP-IP68C-DS-EN 2303